

User Manual

0496 Sniffer Modbus



ENGLISH

Sniffer Modbus for LogiCO2 Safety System.



WARNING!

Please read these instructions carefully prior to start-up and use. These instructions should be saved for future reference and passed on to any subsequent owner. Failure to follow any of these instructions could result in bodily harm or death, and could void product warranties. LogiCO2 International AB, its affiliates and third party providers assume no responsibility for claims arising from improper or careless use or handling of its products. Retain this instruction.

Technical specifications

- Power supply:** 24V DC, from the alarm system
- LED Indications:** See table on page 5
- Ambient temperature:** 0 to +40°C (+32°F to +102°F)
- Cable length:** 2 x 5 m
- Dimensions (LxWxD):** 90 x 161 x 38 mm / 3.5" x 6.3" x 1.5"

Function


The LogiCO2 Sniffer Modbus is a gateway for reading out measuring values and status (e.g. Alarms) from LogiCO2's Safety Systems. It is only possible to read-out information from the Sniffer (read only). The Sniffer Modbus is connected to maximum eight sensors with or without a central unit. The Sniffer is monitoring the communication between the sensor/s and the central unit. If no central unit is installed in the Safety System, the Sniffer Modbus can communicate directly with the Sensor/s. The Sniffer Modbus is intended as a gateway from the LogiCO2 Safety System. The Sniffer Modbus communicates as a slave via Modbus RTU (RS485) to external systems.

The Sniffer Modbus is power supplied from the LogiCO2 Safety System. Default setting is to read-out one Sensor (ID number 1) that is connected to a central unit.

Installation

Connect the cable marked "Connect to sensor" to one of the LogiCO2 Safety System's red cables. Use the cable marked "Connect to external system" to connect the gateway RS485 to the external system.

Pinout red cable:


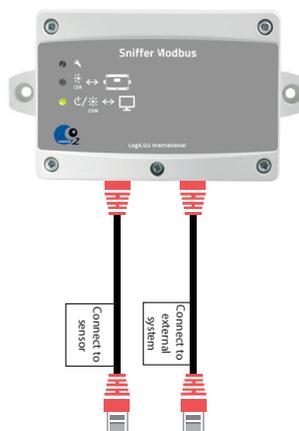


RJ-45 Plug for RS485 Communication

Pin 4 RS485 – (B)

Pin 5 RS485 + (A)

Pin 8 GND

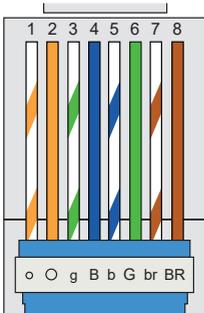


Setup – with or without Central Unit

The default setting of the Sniffer is to communicate with a Safety System together with a Central Unit. To change setting, remove the cover to access the two DIP-switches.


Example (DIP-switch 2):

- To read-out sensors with ID-number 1 and 2, set the DIP-switch number 1 and 2 to ON. All other DIP-switches in OFF-position.
- To read-out sensors with ID-number 2 and 4, set the DIP-switch number 2 and 4 to ON . All other DIP-switches in OFF-position.
- To read-out eight sensors, set the DIP-switch number 1-8 to ON . All other DIP-switches in OFF-position.

PCB Layout

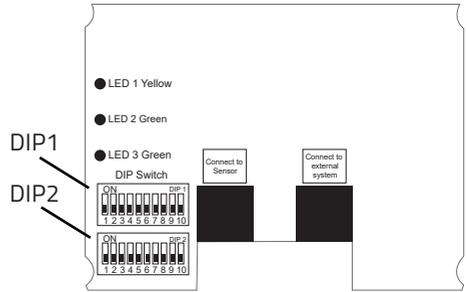


Led Indication

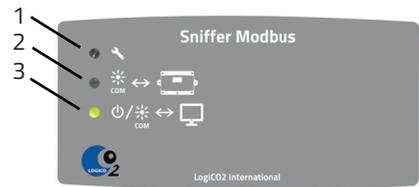


LED	Colour	Information
1	Yellow	Lost communication with sensors
2	Green	Flashing when communicating with sensors
3	Green	Power, flashing when communicating with external system

DIP-Switch settings

DIP-switch 1: For communication with external system.



DIP-switch 2: For communication with LogiCO2 Sensors.



DIP-switch settings, ID-address 1-8

Observe! DIP-switch 1, Dip 1-5

ID-address	Dip1:1	Dip1:2	Dip1:3	Dip1:4	Dip1:5	DIP-switch 1
ID1	OFF	OFF	OFF	OFF	OFF	
ID2	ON	OFF	OFF	OFF	OFF	
ID3	OFF	ON	OFF	OFF	OFF	
ID4	ON	ON	OFF	OFF	OFF	
ID5	OFF	OFF	ON	OFF	OFF	
ID6	ON	OFF	ON	OFF	OFF	
ID7	OFF	ON	ON	OFF	OFF	
ID8	ON	ON	ON	OFF	OFF	



DIP-switch settings, Parity

Observe! DIP-switch 1, Dip 6-7

Parity	Dip1:6	Dip1:7	DIP-switch 1
NONE - 2 stopbit	OFF	OFF	
EVEN - 1 stopbit	ON	OFF	
ODD - 1 stopbit	OFF	ON	
NONE - 1 stopbit	ON	ON	

DIP-switch settings, Baud rate

Observe! DIP-switch 1, Dip 8-9

Baud rate	Dip1:8	Dip1:9	DIP-switch 1
9600	OFF	OFF	
19200	ON	OFF	
38400	OFF	ON	
57600	ON	ON	

DIP-switch settings, Termination resistor 120 Ω Sensor

Observe! DIP-switch 1, Dip 10

Termination resistor 120 Ω (Sensor communication line)	Dip1:10	DIP-switch 1
Not connected	OFF	
Connected	ON	

DIP-switch settings, Selection of Sensor ID to monitor

Observe! DIP-switch 2, Dip 1-8

Sensor-ID to be monitored	Not monitored sensor-ID	Monitored sensor-ID
Dip 2:1 = ID1	OFF	ON
Dip 2:2 = ID2	OFF	ON
Dip 2:3 = ID3	OFF	ON
Dip 2:4 = ID4	OFF	ON
Dip 2:5 = ID5	OFF	ON
Dip 2:6 = ID6	OFF	ON
Dip 2:7 = ID7	OFF	ON
Dip 2:8 = ID8	OFF	ON

DIP-switch settings, Selection of Modbus Master/Slave

Observe! DIP-switch 2, Dip 9

Modbus Master/Slave	Dip2:9	DIP-switch 2
Slave	OFF	
Master	ON	

DIP-switch settings, Termination resistor 120 Ω External

Observe! DIP-switch 2, Dip 10

Termination resistor 120 Ω (External communication line)	Dip2:10	DIP-switch 2
Not connected	OFF	
Connected	ON	

Modbus register

ID 1	ID 2	ID 3	ID 4	ID 5	ID 6	ID 7	ID 8	Register content
1x0001	1x0025	1x0049	1x0073	1x0097	1x0121	1x0145	1x0169	CO2 Alarm B
1x0002	1x0026	1x0050	1x0074	1x0098	1x0122	1x0146	1x0170	CO2 Alarm A
1x0003	1x0027	1x0051	1x0075	1x0099	1x0123	1x0147	1x0171	TWA Alarm
1x0004	1x0028	1x0052	1x0076	1x0100	1x0124	1x0148	1x0172	Temp alarm high
1x0005	1x0029	1x0053	1x0077	1x0101	1x0125	1x0149	1x0173	Temp alarm low
1x0006	1x0030	1x0054	1x0078	1x0102	1x0126	1x0150	1x0174	Res
1x0007	1x0031	1x0055	1x0079	1x0103	1x0127	1x0151	1x0175	Res
1x0008	1x0032	1x0056	1x0080	1x0104	1x0128	1x0152	1x0176	Res
1x0009	1x0033	1x0057	1x0081	1x0105	1x0129	1x0153	1x0177	Fatal error
1x0010	1x0034	1x0058	1x0082	1x0106	1x0130	1x0154	1x0178	Offset error
1x0011	1x0035	1x0059	1x0083	1x0107	1x0131	1x0155	1x0179	Algorithm error
1x0012	1x0036	1x0060	1x0084	1x0108	1x0132	1x0156	1x0180	Output error
1x0013	1x0037	1x0061	1x0085	1x0109	1x0133	1x0157	1x0181	SD error
1x0014	1x0038	1x0062	1x0086	1x0110	1x0134	1x0158	1x0182	Out of range
1x0015	1x0039	1x0063	1x0087	1x0111	1x0135	1x0159	1x0183	Mem error
1x0016	1x0040	1x0064	1x0088	1x0112	1x0136	1x0160	1x0184	Heating
1x0017	1x0041	1x0065	1x0089	1x0113	1x0137	1x0161	1x0185	Sensor type
1x0018	1x0042	1x0066	1x0090	1x0114	1x0138	1x0162	1x0186	Sensor error
1x0019	1x0043	1x0067	1x0091	1x0115	1x0139	1x0163	1x0187	Communication error
1x0020	1x0044	1x0068	1x0092	1x0116	1x0140	1x0164	1x0188	Online
1x0021	1x0045	1x0069	1x0093	1x0117	1x0141	1x0165	1x0189	Res
1x0022	1x0046	1x0070	1x0094	1x0118	1x0142	1x0166	1x0190	Res
1x0023	1x0047	1x0071	1x0095	1x0119	1x0143	1x0167	1x0191	Res
1x0024	1x0048	1x0072	1x0096	1x0120	1x0144	1x0168	1x0192	Res

Value range - 0 or 1

Read/Write - R

IR address	Register content	Read/Write
3x0001	Sensor #1 CO2 value	R
3x0002	Sensor #1 TWA value	R
3x0003	Sensor #1 Temp value (°C)	R
3x0004	Sensor #1 Temp value (°F)	R
3x0005	Sensor #2 CO2 value	R
3x0006	Sensor #2 TWA value	R
3x0007	Sensor #2 Temp value (°C)	R
3x0008	Sensor #2 Temp value (°F)	R
3x0009	Sensor #3 CO2 value	R
3x0010	Sensor #3 TWA value	R
3x0011	Sensor #3 Temp value (°C)	R
3x0012	Sensor #3 Temp value (°F)	R
3x0013	Sensor #4 CO2 value	R
3x0014	Sensor #4 TWA value	R
3x0015	Sensor #4 Temp value (°C)	R
3x0016	Sensor #4 Temp value (°F)	R
3x0017	Sensor #5 CO2 value	R
3x0018	Sensor #5 TWA value	R
3x0019	Sensor #5 Temp value (°C)	R
3x0020	Sensor #5 Temp value (°F)	R
3x0021	Sensor #6 CO2 value	R
3x0022	Sensor #6 TWA value	R
3x0023	Sensor #6 Temp value (°C)	R
3x0024	Sensor #6 Temp value (°F)	R
3x0025	Sensor #7 CO2 value	R
3x0026	Sensor #7 TWA value	R
3x0027	Sensor #7 Temp value (°C)	R
3x0028	Sensor #7 Temp value (°F)	R
3x0029	Sensor #8 CO2 value	R
3x0030	Sensor #8 TWA value	R
3x0031	Sensor #8 Temp value (°C)	R
3x0032	Sensor #8 Temp value (°F)	R

Maintenance

The LogiCO2-Sniffer requires no maintenance.

Important

All persons responsible for the use and maintenance of this equipment must read and understand the safety and operating information contained in this guide. Installation and service of this equipment should be performed only by professionals. The function of the equipment will be impaired if it is not properly installed.

Important information regarding third party products

The functionality of LogiCO2's products are only warranted if connected to LogiCO2's systems and products. LogiCO2 is not liable for the functionality of any systems if LogiCO2 components or parts are connected to third party products. LogiCO2 permits its products to be connected to external relays controlling ventilation and valves as well as fire alarm panels and building management systems.

Subject to typographical errors and change without prior notice.



Manufactured by:

LogiCO2 International AB
Box 9097
400 92 Gothenburg, Sweden

E-mail: info@logico2.com
Web: www.logico2.com